


Notes:

- Cylinder - Min Burst Pressure 5.0 MPa
- Cylinder - Test Pressure 1.8 MPa
- Valve - Leak Test (30 Sec) 1.5 MPa
- Valve - Test Pressure (60 Sec) 2.7 MPa
- Powder Coated (RAL 3000) Min 0.07mm
- All measurements shown are in mm
- All Bracket Back Holes are 6mm

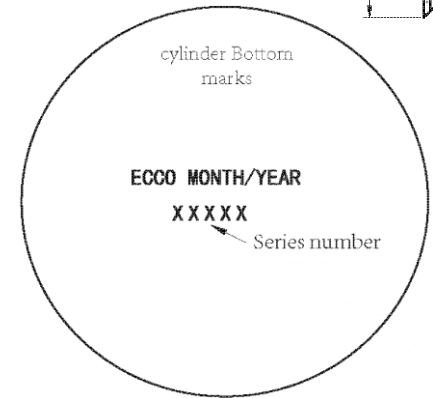

Advocavi S.A.				
Drawn By PM	Approved By	Title 1.0 kg ABC Fire Extinguisher	Drawing No NF1L	Rev. B
Scale	Date 20-10-17			